


# THREADED ACCESSORIES



## STEEL EYE SOCKET

**FIG. 36**

- Function:** Designed for attaching hanger rod to structures. Secured with listed fasteners.
- Material:** Carbon steel
- Finish:** Electro-galvanized
- Approvals:** Underwriters' Laboratories Listed in the U.S. (UL), Canada (CUL), and Factory Mutual Approved.
- Ordering:** Specify figure number and rod size.

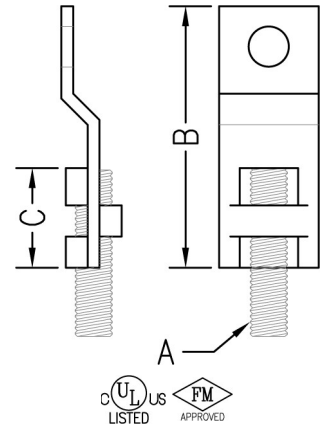

Rod Size A	Max. Pipe Size		Screw Size	B		C		Max. Rec. Load		Wt. Each	
								lbs.	kN	lbs.	kg
3/8	2	(50)	3/8 X 2 1/2 Lag	2 5/8	(66.68)	1 1/16	(26.99)	400	(1.78)	.08	(.04)
3/8	4	(100)	3/8 Bolt	2 5/8	(66.68)	1 1/16	(26.99)	730	(3.25)	.08	(.04)

- THREADED ACCESSORIES
- CPVC STRAPS
- BAND HANGERS
- BEAM CLAMPS
- CLEVIS HANGERS
- PIPE ROLLER SUPPORTS
- SPLIT RING HANGERS
- PIPE CLAMPS
- CENTER LOAD BEAM CLAMPS
- PIPE SHIELDS, INSULATION, & SADDLES
- PIPE GUIDES & SLIDES
- WALL BRACKETS
- PIPE SUPPORTS
- STRUCTURAL ATTACHMENTS
- SEISMIC BRACING



**PHD Manufacturing, Inc.**

44018 Columbiana-Waterford Road  
 Columbiana, Ohio 44408-9481  
 Phone: 800-321-2736 • 330-482-9256  
 Fax: 330-482-2763  
 Web: www.phd-mfg.com

**FIGURE 36 INSTALLATION INSTRUCTIONS**

- FUNCTION:** Designed for attaching hanger rod to structures
- APPROVALS:** Underwriters Laboratories listed and Factory Mutual approved
- MATERIAL:** Carbon Steel
- FINISH:** Electro-galvanized
- WARNINGS:** The safety of the total system involves a system designer, installer, and user. The manufacturer has limited or no control over such factors as environmental conditions, total system design, product selection, and maintenance. The installer is responsible for the application to conform to local codes, the integrity of attaching structure, and the use of proper fasteners. Failure to follow these specifications may result in product malfunction. All load ratings are for static conditions and neglect dynamic loading of any kind. Observe all safety regulations for your surroundings while installing.
- INSTALLATION:** Attach Fig. 36 to structure using one 3/8" bolt to a steel structure, or one 3/8" X 2 1/2" lag screw when attaching to wood structure. Refer to NFPA13 when utilizing Fig. 36 in fire protection system or when attaching to structure other than wood. A 3/8" threaded rod can then be threaded into the mounted Fig. 36 and used to support piping. Make sure the rod is threaded as far into the Fig. 36 as possible.

UL Listed Fasteners		
Pipe Size	Qty.	When Using This fastener
2	1	3/8" X 2 1/2" Screw
4	1	3/8" Bolt



*The Complete Line of Pipe Supports and Devices*  
 Pipe Hangers ▲ Strut & Accessories ▲ Pipe Clamps ▲ Beam Clamps ▲ Shields